




MIXED FLOW  
PUMP  
PERFORMANCE

1 STAGE  
#24 PUMP  
700 R.P.M.  
K 155.0

IMPELLERS CAN BE TRIMMED TO MEET ANY CONDITION BETWEEN LINES SHOWN.

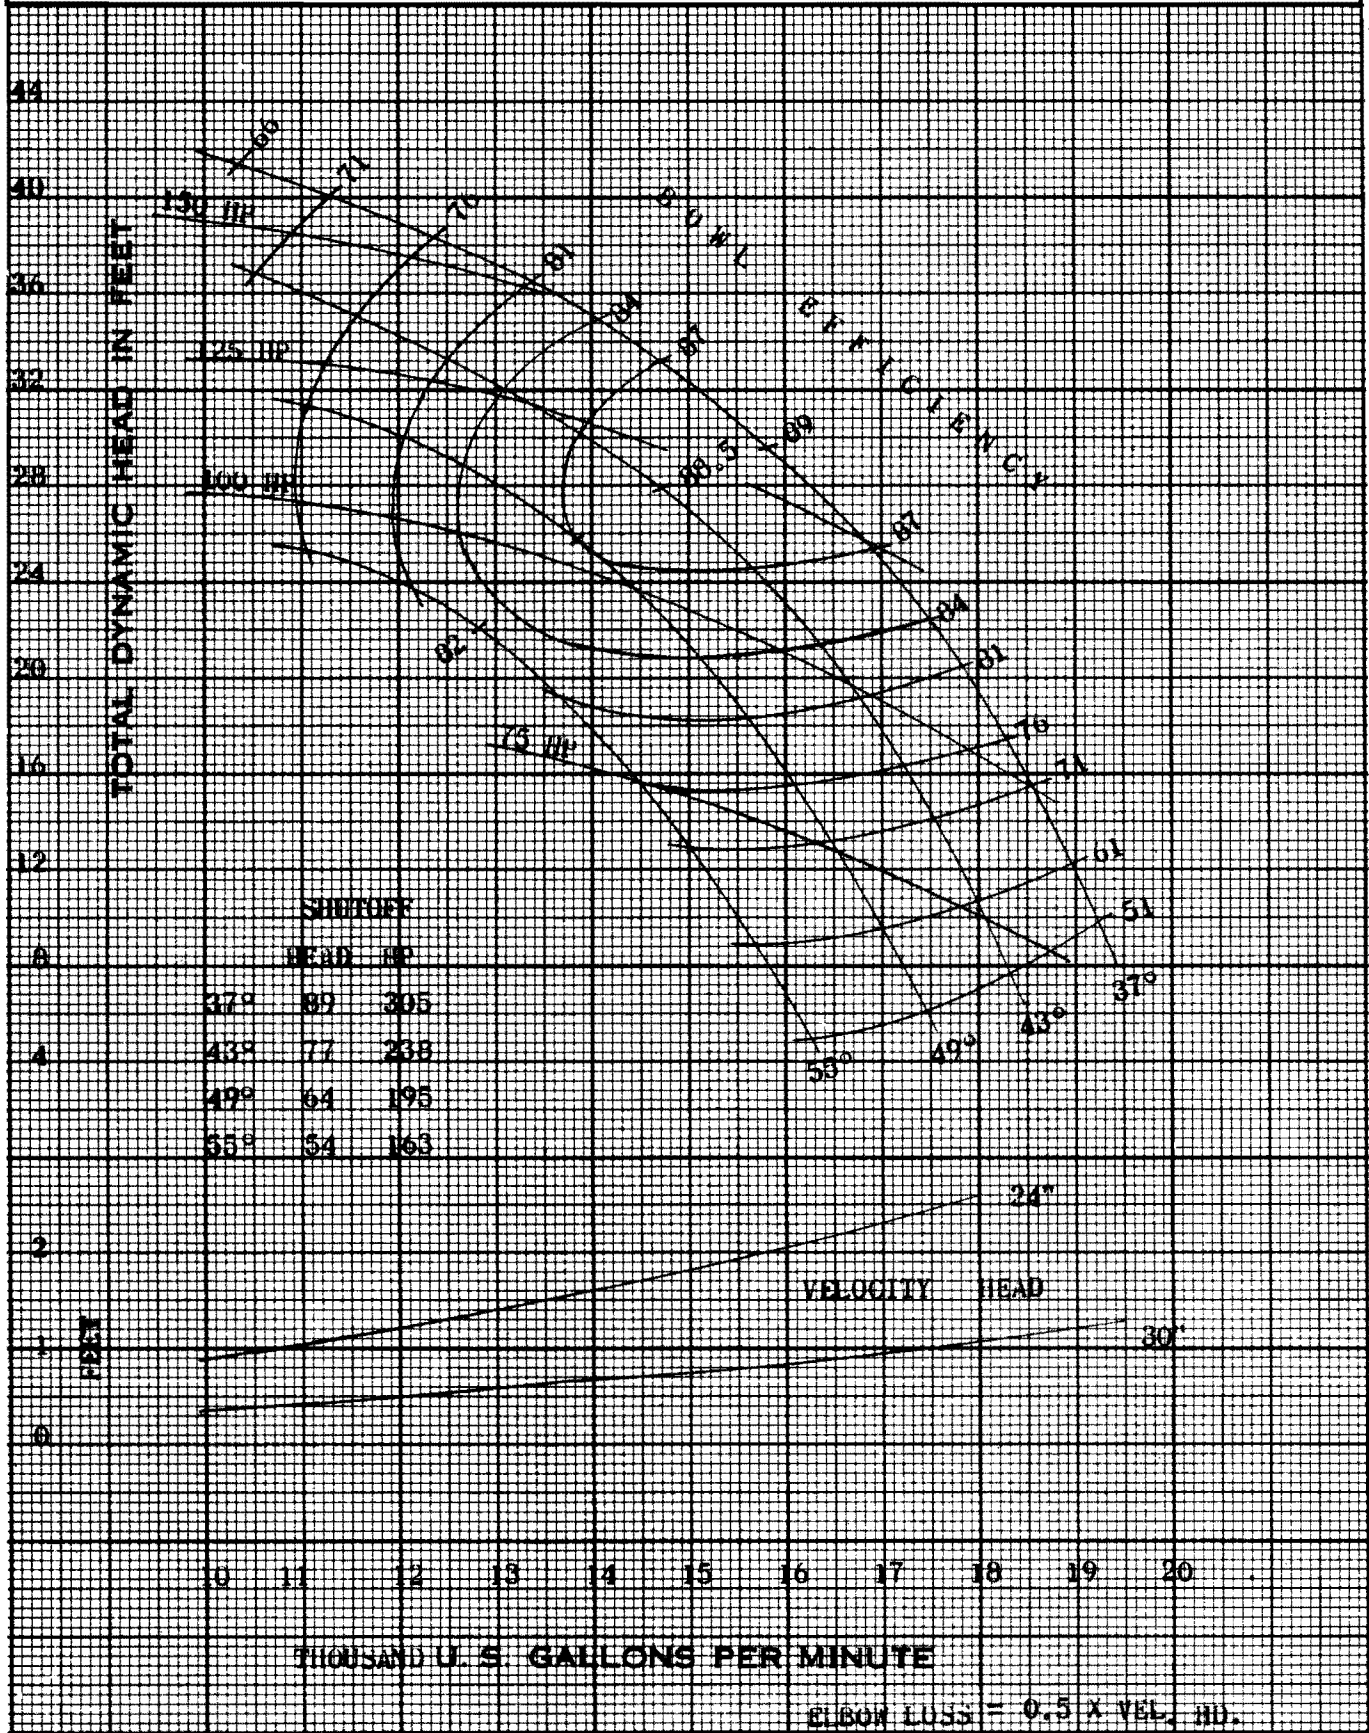


LAYNE & BOWLER PUMP COMPANY    LOS ANGELES, CALIFORNIA



MIXED FLOW  
PUMP  
PERFORMANCE

1 STAGE  
#24 PUMP  
700 R.P.M.  
K 155.0

IMPELLERS CAN BE TRIMMED TO MEET ANY CONDITION BETWEEN LINES SHOWN.

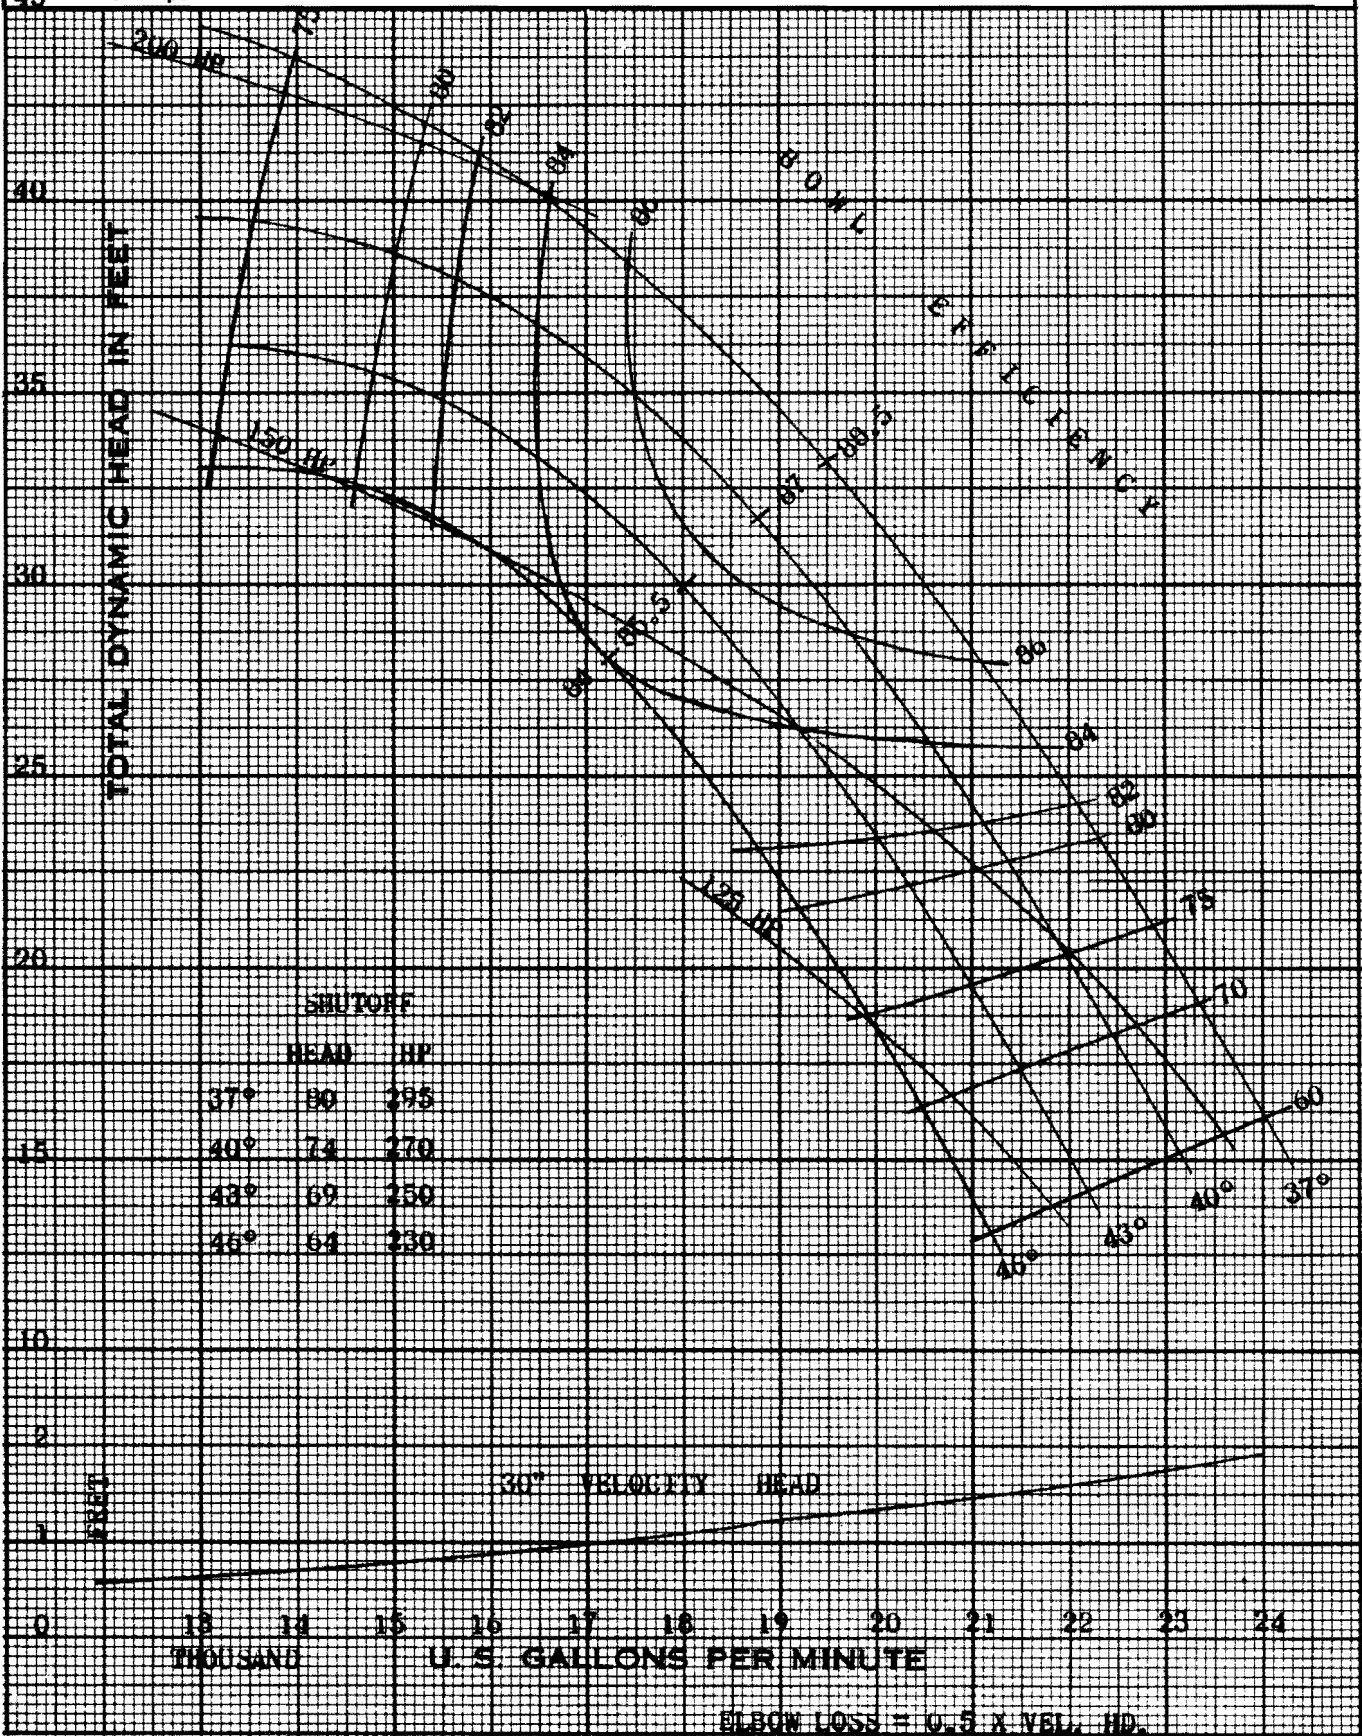


LAYNE & BOWLER PUMP COMPANY    LOS ANGELES, CALIFORNIA



MIXED FLOW  
PUMP  
PERFORMANCE

1 STAGE  
#24 PUMP  
700 R.P.M.  
K 155.0

IMPELLERS CAN BE TRIMMED TO MEET ANY CONDITION BETWEEN LINES SHOWN.

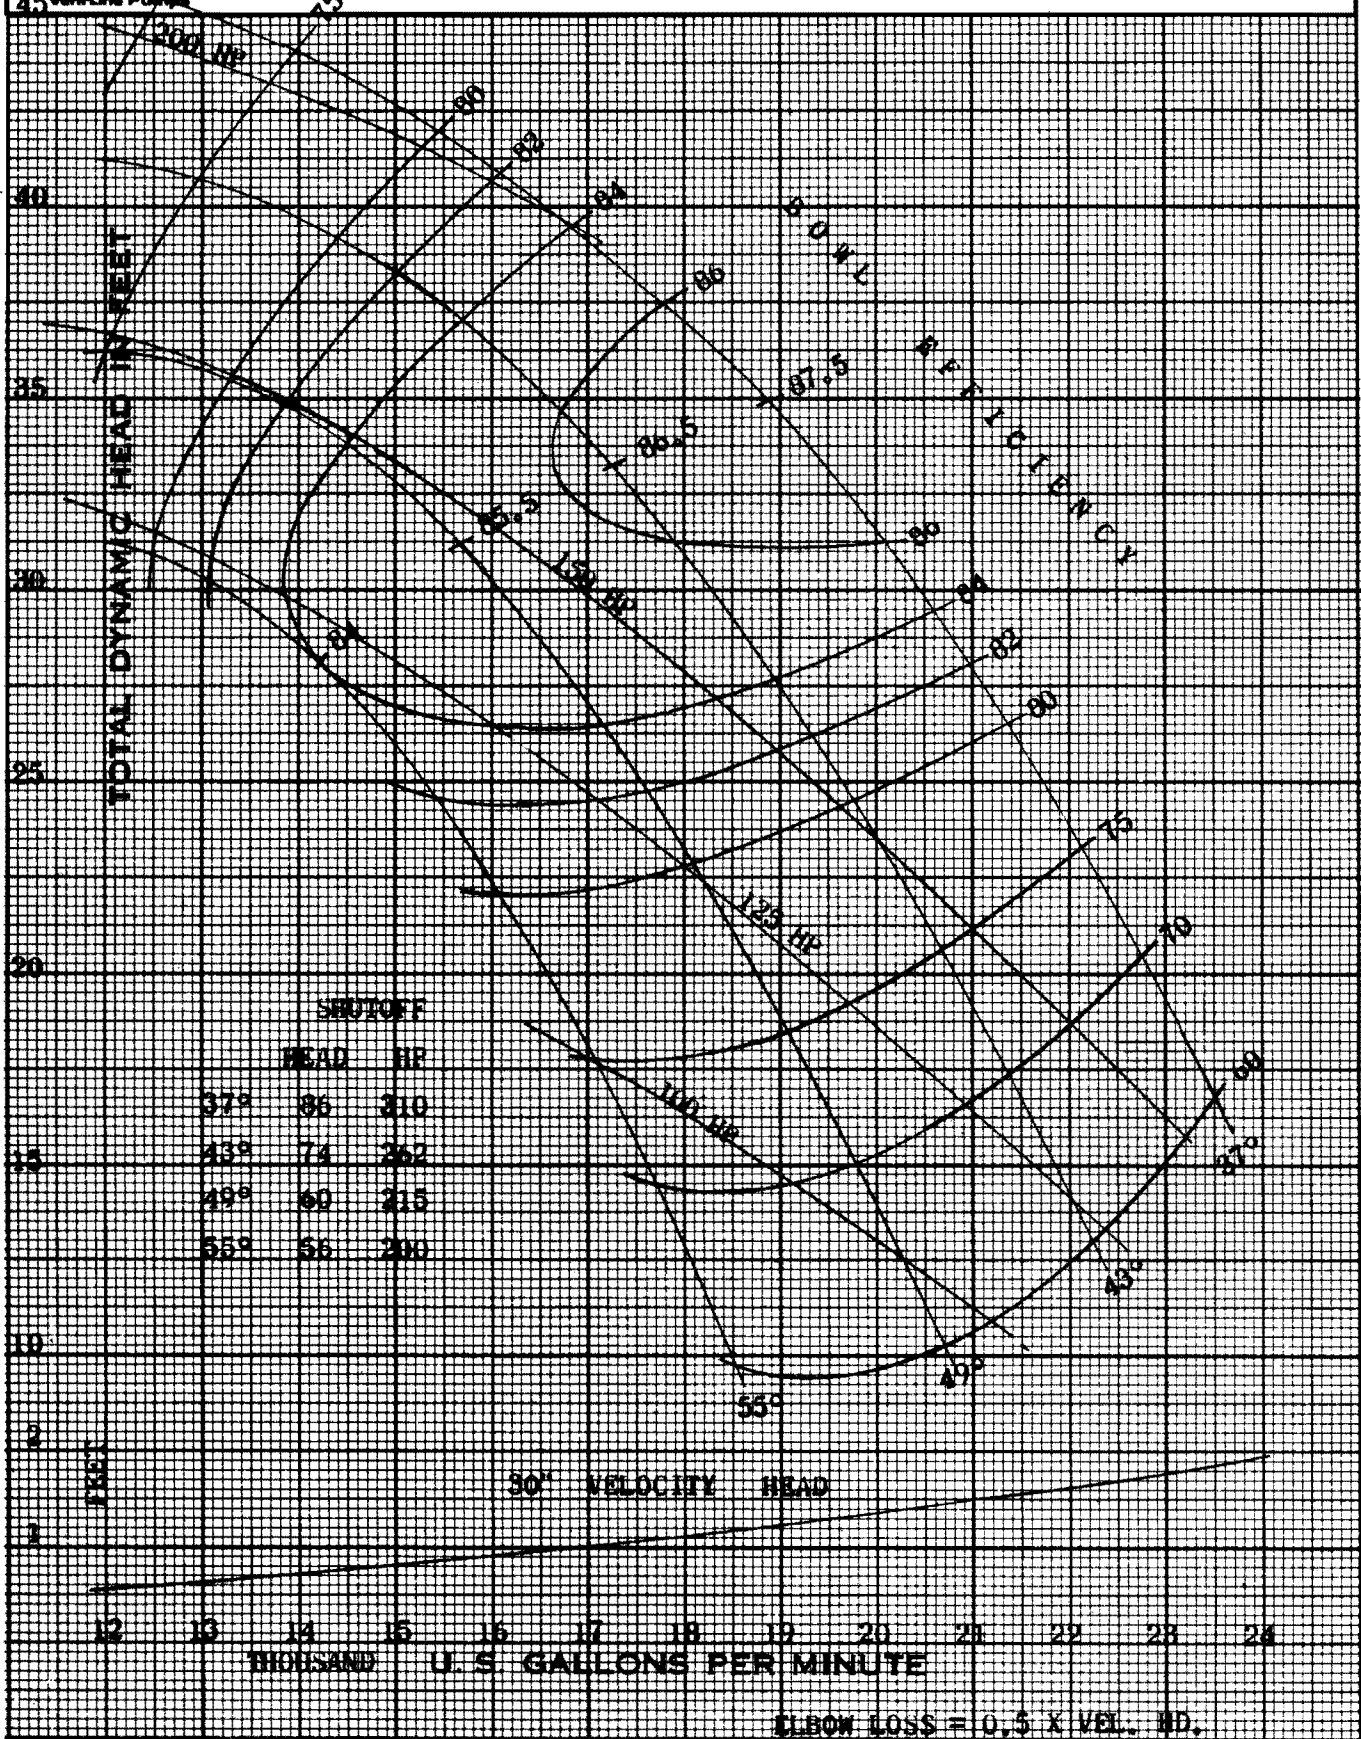


LAYNE & BOWLER PUMP COMPANY      LOS ANGELES, CALIFORNIA



MIXED FLOW  
PUMP  
PERFORMANCE

1 STAGE  
#24 PUMP  
700 R.P.M.  
K 155.0

IMPELLERS CAN BE TRIMMED TO MEET ANY CONDITION BETWEEN LINES SHOWN.

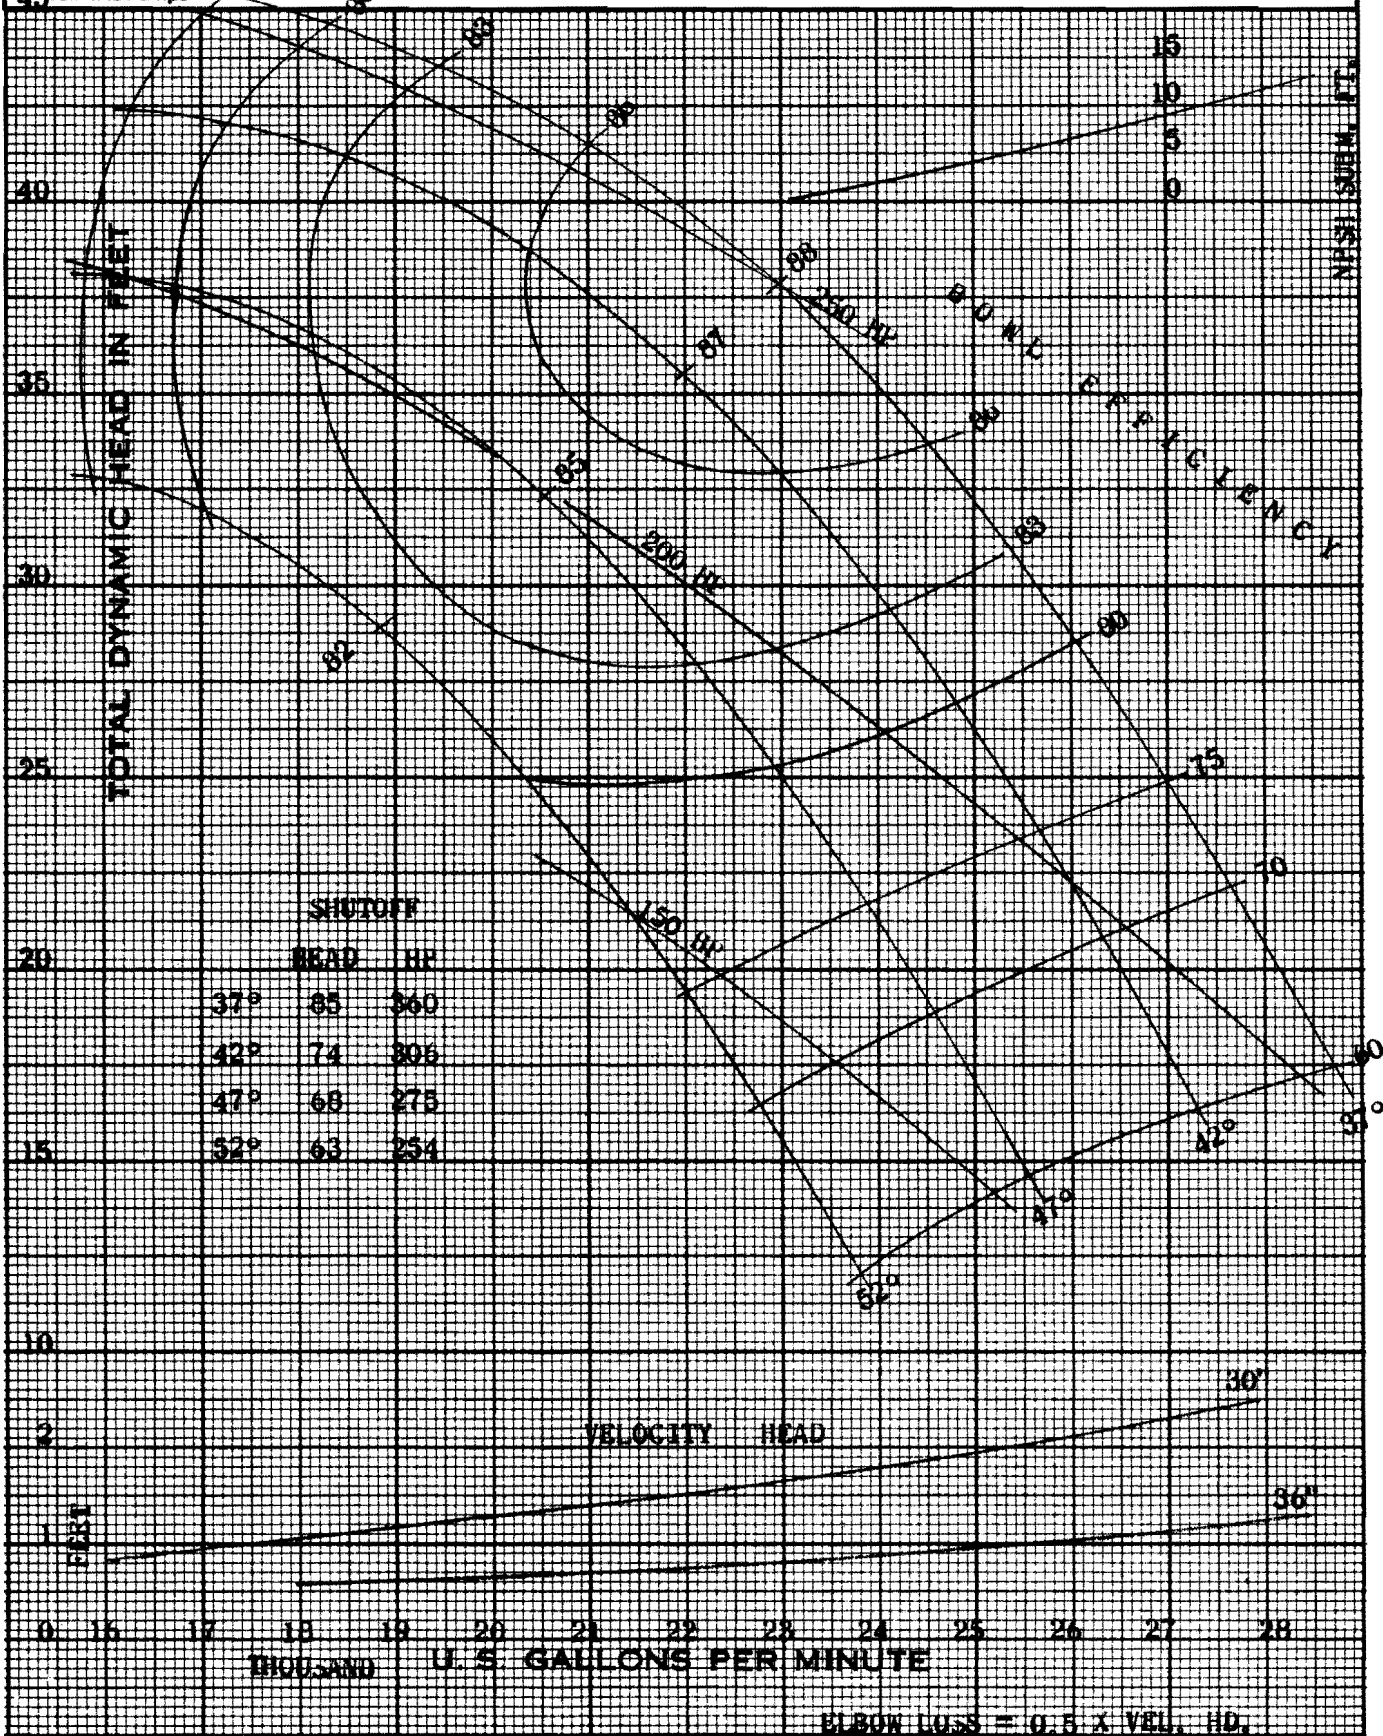

LAYNE & BOWLER PUMP COMPANY    LOS ANGELES, CALIFORNIA